



Suwannee-Satilla Regional Water Planning Council

WATER & WASTEWATER FORECASTING TECHNICAL MEMORANDUM

Supplemental Material | Suwannee-Satilla Regional Water Plan

MARCH 2024



Table of Contents

Section 1 Introduction	1-1
1.1 General Methodology.....	1-1
1.2 Population Update.....	1-2
Section 2 Municipal Water Forecasting	2-1
2.1 Methodology	2-1
2.1.1 Gallons per Capita per Day.....	2-1
2.1.2 Plumbing Code Adjustment Factor.....	2-2
2.2 Municipal Water Forecasting Results	2-3
2.3 Municipal Water Forecast Allocations.....	2-5
Section 3 Municipal Wastewater Forecasting	3-1
3.1 Methodology	3-1
3.2 Results	3-2
Section 4 Industrial Forecasting	4-1
4.1 Methodology	4-1
4.2 Results	4-1
4.2.1 Industrial Water Forecasts	4-1
4.2.2 Industrial Wastewater Results.....	4-2
Section 5 Agricultural Water Forecasting.....	5-1
5.1 Methodology	5-1
5.2 Results	5-2
Section 6 Energy Water Forecasting	6-1
6.1 Methodology	6-1
6.2 Results	6-2
Section 7 Regional Summary.....	7-1
7.1 Water Demand Summary	7-1
7.2 Wastewater Summary.....	7-6
Section 8 References	7-1

List of Figures

Figure 1-1 Georgia’s Historic Population and Growth Projections.....	1-2
Figure 1-2 Suwannee-Satilla Population Projections	1-3
Figure 2-1 Forecasted Municipal Water Demand for Suwannee-Satilla Planning Council	2-4
Figure 2-2 Self-Supply Versus Public-Supply of Municipal Water Demand	2-5
Figure 2-3 Municipal Water Demand for Suwannee-Satilla Planning Council by Aquifer and Basin	2-6
Figure 3-1 Total Wastewater Generated Suwannee-Satilla Planning Region by Type	3-3
Figure 3-2 2020 Snapshot of Wastewater Discharge Type per Watershed.....	3-3
Figure 5-1 Agricultural Water Demand by Source Water Type	5-3
Figure 7-1 Regional Water Demand by Basin and Aquifer	7-1
Figure 7-2 Regional Water Demand by Sector	7-2
Figure 7-3 County Water Demand by Sector for 2015.....	7-2
Figure 7-4 Regional Wastewater Discharge per Basin.....	7-6
Figure 7-5 Regional Wastewater Discharge per Method	7-6

List of Tables

Table 1-1 Population Projections per County.....	1-3
Table 2-1. Per Capita Demand Values by County, gpcd	2-2
Table 2-2. Adjusted Public-Supplied GPCD	2-3
Table 2-3 Average Annual Municipal Water Demand Forecast by County (MGD)	2-4
Table 3-1 Total Wastewater Generated in Suwannee-Satilla Planning Region per County (MGD)....	3-2
Table 4-1 Industrial Water Demand Forecast per County (MGD)	4-2
Table 4-2 Industrial Water Demand Forecast per Industry (MGD)	4-2
Table 4-3 Industrial Wastewater Generation Forecast per County (MGD)	4-3
Table 4-4 Industrial Wastewater Generation Forecast by Discharge Method (MGD).....	4-3
Table 5-1 Suwannee-Satilla Agricultural Demand Forecast by County (MGD)	5-2
Table 5-2 Suwannee-Satilla Agricultural Demand Forecast per Source (MGD).....	5-3
Table 6-1 Suwannee-Satilla Forecasted Energy Sector Demands (MGD).....	6-2
Table 7-2 Summary of Regional Wastewater Flows per County (MGD)	7-7

Section 1

Introduction

Municipal and Industrial Water and Wastewater Forecasts were originally developed for the Suwannee-Satilla Regional Water Planning Council as part of the Georgia Comprehensive Statewide Water Management Plan (CSWMP) in 2011. Agricultural and Energy water needs were also identified and forecasted during the 2011 planning process. As part of the 5-year review and revision of that plan, all of these forecasts, with the exception of the Industrial water and wastewater forecasts, were updated in 2017. In support of the 2023 plan update, the Agricultural, Energy, Municipal, and Industrial water and wastewater forecasts have been updated. This Technical Memorandum describes how the forecasts have been modified to account for changes in population and water use that have occurred since the 2017 forecasts were produced.

Throughout this report, the prior Regional Planning process that occurred in 2009 – 2011 is referred to as “Round 1” and the 2017 update is referred to as “Round 2”. Thus, the current (2023) update is referred to as “Round 3”.

The basic approach to updating the forecasts starts with the same methodology used in developing the Round 2 forecasts, which are described in various Technical Memoranda included as supplemental materials to the 2017 Suwannee-Satilla Regional Water Plan.¹ The purpose of this Technical Memorandum is to describe where modifications to the Round 2 forecast methodology were made and to provide the revised forecast values.

1.1 General Methodology

The basic methodology for forecasting water demand is to estimate demand separately for each major water use sector. For each sector, water demand is estimated using a 'driver' multiplied by the 'rate of use'. The driver is defined as a countable unit that can be projected in future years, such as number of people, acres irrigated or megawatts of power. The rate of use is defined as the quantity of water used by the driving unit per unit of time, such as gallons per person per day, gallons per day per acre, or gallons per megawatt produced.

The planning process examines and forecasts water demand for four major sectors:

- **Municipal** – this sector includes domestic, commercial, and low water use industries
- **Industrial** – this sector includes higher water use industries

¹ See “Suwannee-Satilla Regional Water Plan,” dated June 2017 (available at <https://waterplanning.georgia.gov/suwannee-satilla-regional-water-plan>);

“Suwannee-Satilla Water and Wastewater Forecasting Technical Memorandum,” dated March, 2017 (available at [Suwannee-Satilla Region Technical Information | Georgia Water Planning](#))

- **Agricultural** – this sector includes major crops such as cotton, corn, peanuts, soybean, pecans, specialty crops, and nursery and horticulture; a snapshot of major livestock water use and golf course water use
- **Energy** – this sector includes thermoelectric power generation

1.2 Population Update

State and County population projections are provided by the Governor’s Office of Planning and Budget (OPB). These projections are used consistently throughout the state for multiple purposes such as transportation planning and allocation of education funds. The Georgia Environmental Protection Division (EPD) is required to use these population projections in statewide water planning. The 2010 Census statewide population count was lower than had been projected for 2010 in the Round 1 projections, although this trend of lower population than projected does not hold true for all counties. The Round 1 forecast had the State’s population growing at an annual rate of 1.83 percent while the current updated forecast grows at an annual rate of only 0.87 percent as shown in **Figure 1-1**.

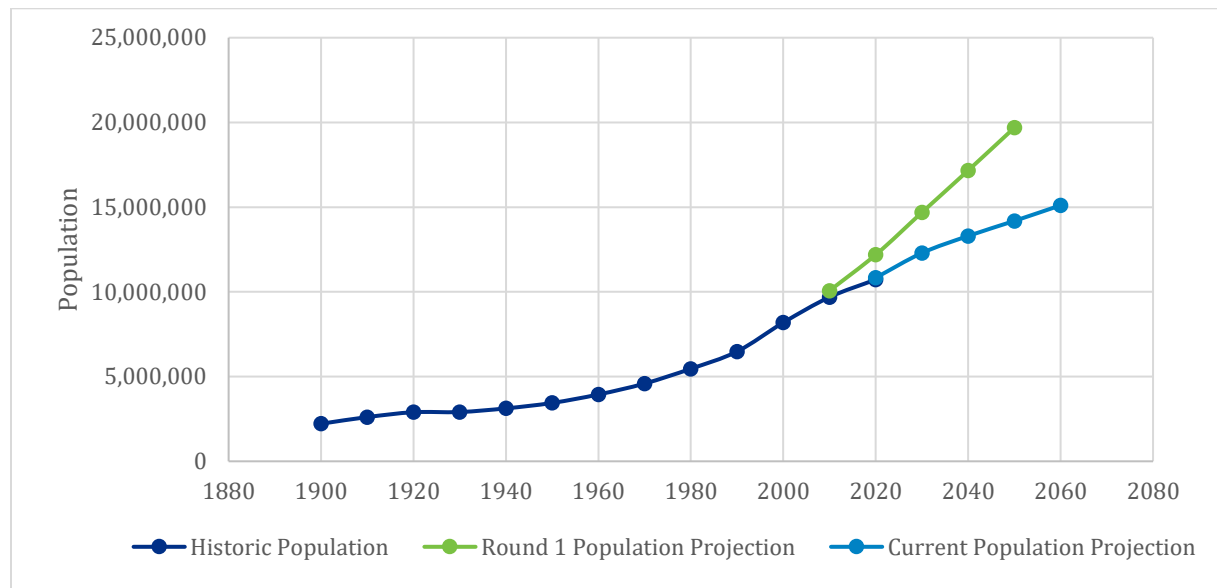


Figure 1-1
Georgia’s Historic Population and Growth Projections

While the trend of a lower population in 200 than projected was seen statewide, each county had its own individual trend. For the region as a whole, the population obtained from the 2019 OPB data was 9.5 percent lower than the Round 1 projection for 2020. In addition, lower growth rates moving forward are predicted leading to a projected population in 2050 that is 33 percent less than the Round 1 estimate as shown in **Figure 1-2**. The new population projections (OPB, 2019) by county are shown in **Table 1-1**.

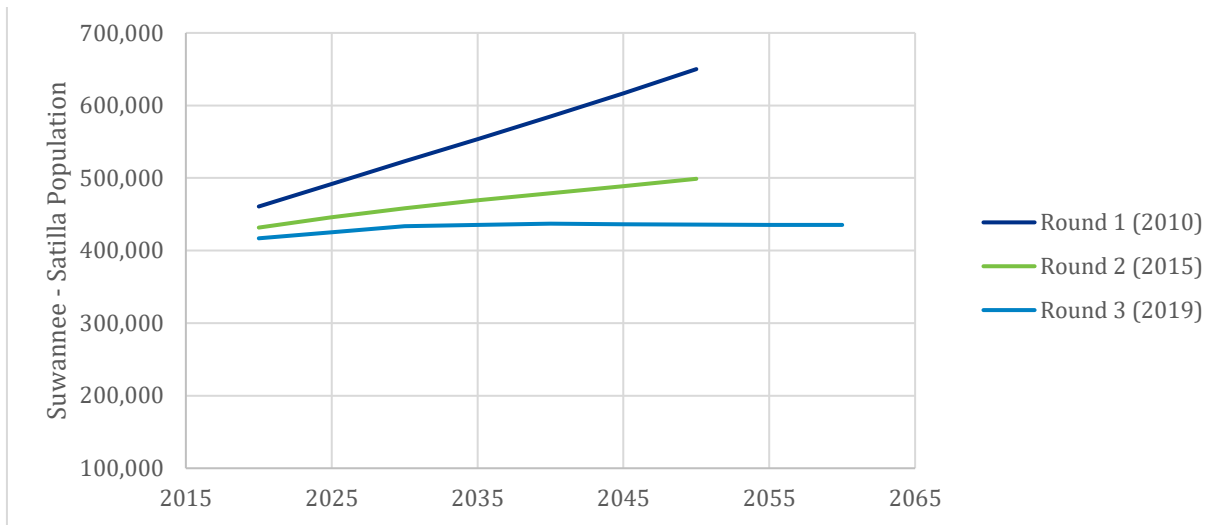


Figure 1-2
Suwannee-Satilla Population Projections

Table 1-1 Population Projections per County

County	2020	2025	2030	2035	2040	2045	2050	2055	2060
Atkinson	8,330	8,445	8,560	8,584	8,607	8,576	8,545	8,502	8,459
Bacon	11,404	11,781	12,157	12,042	11,927	11,646	11,364	11,042	10,720
Ben Hill	16,645	16,503	16,361	16,042	15,722	15,321	14,920	14,603	14,286
Berrien	19,276	19,604	19,932	20,076	20,219	20,231	20,243	20,307	20,370
Brantley	19,202	19,764	20,326	20,081	19,836	19,166	18,495	17,587	16,678
Brooks	15,727	15,946	16,164	15,717	15,270	14,596	13,921	13,301	12,681
Charlton	13,251	13,501	13,751	13,434	13,116	12,625	12,133	11,571	11,008
Clinch	6,656	6,758	6,859	6,929	6,999	7,130	7,260	7,489	7,718
Coffee	43,042	43,299	43,555	43,416	43,277	42,996	42,714	42,442	42,169
Cook	17,437	17,820	18,202	17,888	17,574	16,972	16,369	15,649	14,929
Echols	3,969	3,915	3,861	3,765	3,668	3,524	3,380	3,234	3,087
Irwin	9,433	9,624	9,815	9,933	10,050	10,145	10,240	10,362	10,484
Lanier	10,351	10,377	10,402	10,438	10,473	10,476	10,479	10,527	10,575
Lowndes	117,878	121,777	125,675	128,140	130,605	132,799	134,992	137,663	140,334
Pierce	19,545	19,954	20,362	20,665	20,967	21,198	21,429	21,662	21,894
Tift	40,830	41,520	42,209	42,596	42,983	43,098	43,212	43,361	43,510
Turner	8,076	8,205	8,334	8,100	7,865	7,598	7,330	7,063	6,795
Ware	35,853	36,440	37,027	37,475	37,923	38,280	38,636	39,187	39,738
Total	416,905	425,229	433,552	435,317	437,081	436,372	435,662	435,549	435,435

Section 2

Municipal Water Forecasting

This section describes the methodology and results of municipal water demand forecasts for the Suwannee-Satilla Planning Region.

2.1 Methodology

The county level municipal water demand includes both public-supplied (i.e., utility) water demand and self-supplied (i.e., private well) water demand. The self-supplied water is associated with groundwater use, while the public-supply water is associated with either surface water or groundwater use as indicated by active permit data. Each county has an average weighted per capita water use value that was derived from an analysis of all reporting utilities within each county. In Round 1, 2005 utility data was used to determine the gpcd average for each county. In Round 2, the Round 1 gpcd values were adjusted based on the utility level data over the most recent four years. In Round 3, the county gpcd averages were based on utility water loss audits and then vetted through the regional councils. The following sections describe updates to the previous methodology used to produce the revised forecasts.

2.1.1 Gallons per Capita per Day

The Georgia EPD compiled and reviewed water loss audit data reported annually for water systems serving populations of 3,300 or more as mandated by the Georgia Water Stewardship Act (2011). The water supplied input value from the audit information was then divided by the population served from EPA's Safe Drinking Water Information System (SDWIS) database to calculate the total per capita water use of a system. A weighted average for counties with more than one system was developed using water loss audit data from 2015 to 2018. To account for treatment loss, three percent was added to counties that have a surface water treatment plant as these systems typically have an in-plant water use that offsets the water produced.

If no data were available to EPD, withdrawal information was divided by the population served value provided by the SDWIS database to calculate the per capita water use. Of the counties with available data, roughly one-half had a decrease in gpcd while the other half showed an increase in gpcd. Note that a decrease in gpcd could be due to conservation and water loss control efforts during this time period, or other factors such as an increase in population with less increase in water use, or a drop in water use (e.g., loss of industrial customer) with the same population. **Table 2-1** shows the Round 2 gpcd for each county in the region compared to the current updated gpcd.

The self-supplied value of 100 gpcd for each county remains unchanged from Round 1.

Table 2-1. Per Capita Demand Values by County, gpcd

County	Round 2 Per Capita	Updated Per Capita	% Change
Atkinson	111	109	-2%
Bacon	177	141	-20%
Ben Hill	177	163	-8%
Berrien	128	128	0%
Brantley	96	115	20%
Brooks	147	162	10%
Charlton	128	115	-10%
Clinch	140	137	-2%
Coffee	139	179	29%
Cook	131	170	30%
Echols	96	75	-22%
Irwin	148	170	15%
Lanier	143	99	-31%
Lowndes	129	169	31%
Pierce	131	73	-44%
Tift	153	179	17%
Turner	140	212	51%
Ware	109	103	-6%

2.1.2 Plumbing Code Adjustment Factor

In Rounds 1 and 2, the gpcd for each county was reduced over time due to the effects of plumbing codes based upon the age of housing stock in each county. Over time, as new houses are built with more efficiency fixtures, the county average gpcd will decrease. Previously, a reduction (adjustment) was calculated for each county starting with zero in 2010 (the base year in Round 1) and increasing over time. For the current update, the plumbing code adjustment was extrapolated using the 2017 Regional Water Plan plumbing code adjustment. The revised plumbing code adjustment was then applied to both public-supplied and self-supplied municipal water demand. **Table 2-2** shows the municipal public-supplied gpcd value over time for each county.

Table 2-2. Adjusted Public-Supplied GPCD

County	2020	2025	2030	2035	2040	2045	2050	2055	2060
Atkinson	109.1	107.8	106.5	105.2	104.0	102.7	101.4	100.2	98.9
Bacon	141.4	139.9	138.5	137.1	135.7	134.3	132.8	131.4	130.0
Ben Hill	163.0	161.7	160.3	159.0	157.7	156.3	155.0	153.6	152.3
Berrien	128.1	126.9	125.7	124.4	123.2	122.0	120.7	119.5	118.3
Brantley	114.9	113.8	112.6	111.5	110.3	109.2	108.0	106.9	105.7
Brooks	161.7	160.4	159.1	157.9	156.6	155.3	154.1	152.8	151.5
Charlton	115.2	114.0	112.9	111.7	110.5	109.3	108.1	107.0	105.8
Clinch	137.0	135.7	134.4	133.1	131.8	130.5	129.2	127.9	126.6
Coffee	178.9	177.8	176.6	175.4	174.2	173.1	171.9	170.7	169.5
Cook	170.0	168.7	167.4	166.1	164.8	163.6	162.3	161.0	159.7
Echols	75.0	73.9	72.7	71.6	70.4	69.3	68.1	67.0	65.8
Irwin	169.9	168.6	167.3	166.1	164.8	163.5	162.2	160.9	159.7
Lanier	98.8	97.7	96.5	95.4	94.3	93.1	92.0	90.9	89.8
Lowndes	169.2	168.1	167.0	165.8	164.7	163.6	162.4	161.3	160.1
Pierce	72.5	71.3	70.0	68.7	67.5	66.2	64.9	63.7	62.4
Tift	178.5	177.2	176.0	174.7	173.4	172.1	170.9	169.6	168.3
Turner	212.0	210.6	209.3	207.9	206.5	205.2	203.8	202.4	201.1
Ware	103.3	101.8	100.4	98.9	97.5	96.0	94.5	93.1	91.6

2.2 Municipal Water Forecasting Results

Table 2-3 shows the forecasted municipal water demand in millions of gallons per day (MGD) (public-supplied and self-supplied) by county in the Suwannee-Satilla region. The total regional demand is shown graphically in **Figure 2-1** along with a comparison of the Round 1 estimates. Region-wide the current municipal forecast is lower than in Round 1 but higher than in Round 2 due to the combination of lower population projections and higher per capita water use values.

Table 2-3 Average Annual Municipal Water Demand Forecast by County (MGD)

County	2020	2025	2030	2035	2040	2045	2050	2055	2060	% Change
Atkinson	0.87	0.87	0.87	0.87	0.86	0.84	0.83	0.81	0.80	-8.3%
Bacon	1.34	1.37	1.40	1.37	1.34	1.29	1.24	1.19	1.14	-15.1%
Ben Hill	2.45	2.40	2.36	2.29	2.23	2.15	2.07	2.01	1.95	-20.4%
Berrien	2.14	2.15	2.17	2.16	2.15	2.12	2.10	2.08	2.06	-3.7%
Brantley	1.96	1.99	2.02	1.98	1.93	1.84	1.76	1.65	1.55	-21.0%
Brooks	2.05	2.06	2.07	1.99	1.91	1.81	1.71	1.62	1.52	-25.7%
Charlton	1.43	1.44	1.45	1.41	1.36	1.29	1.23	1.16	1.09	-24.2%
Clinch	0.81	0.81	0.81	0.81	0.81	0.82	0.82	0.84	0.85	6.0%
Coffee	7.29	7.36	7.48	7.57	7.66	7.67	7.67	7.63	7.60	4.2%
Cook	2.38	2.41	2.44	2.37	2.31	2.20	2.11	1.99	1.88	-20.9%
Echols	0.40	0.39	0.38	0.36	0.35	0.33	0.31	0.30	0.28	-29.4%
Irwin	1.16	1.18	1.19	1.19	1.19	1.19	1.19	1.19	1.19	2.0%
Lanier	1.03	1.02	1.01	1.00	0.99	0.98	0.97	0.96	0.96	-7.1%
Lowndes	18.25	18.71	19.17	19.40	19.63	19.80	19.98	20.22	20.45	12.1%
Pierce	1.73	1.74	1.75	1.75	1.75	1.74	1.73	1.72	1.72	-0.8%
Tift	6.24	6.30	6.35	6.35	6.35	6.32	6.28	6.24	6.21	-0.5%
Turner	1.40	1.41	1.42	1.37	1.32	1.27	1.21	1.16	1.10	-21.2%
Ware	3.69	3.70	3.71	3.70	3.69	3.66	3.64	3.64	3.63	-1.7%
Total	56.63	57.32	58.05	57.94	57.82	57.33	56.85	56.41	55.98	-1.2%

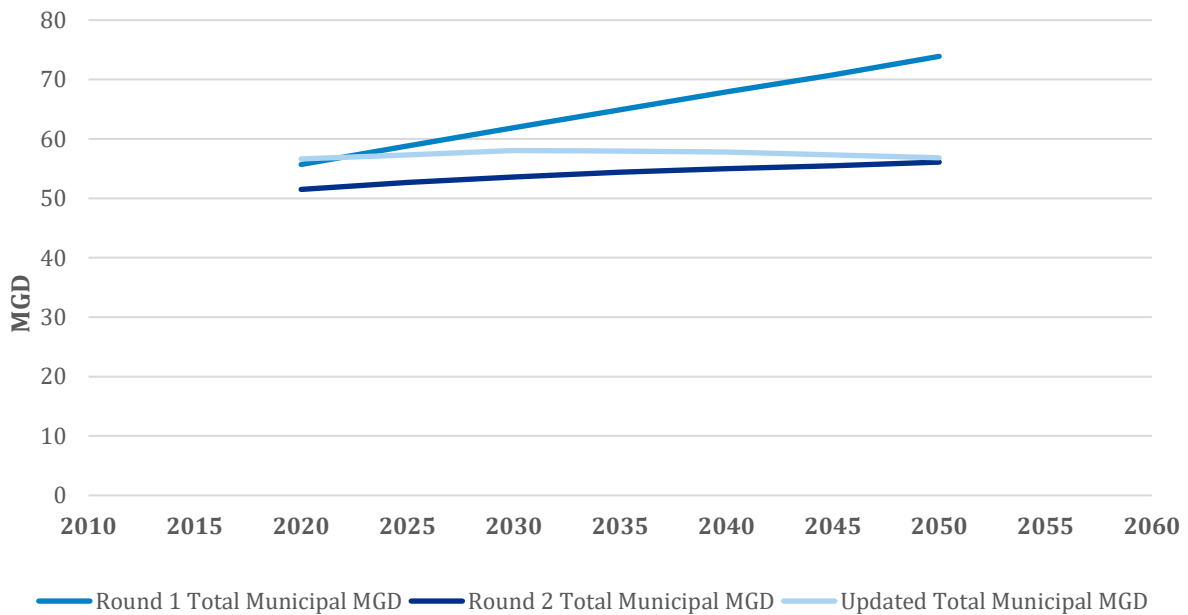


Figure 2-1
Forecasted Municipal Water Demand for Suwannee-Satilla Planning Council

2.3 Municipal Water Forecast Allocations

As noted above, the municipal water demand for each county is the summation of the public-supplied and self-supplied water demand estimates for each county. The percent of county population that is public-supplied and self-supplied varies from Round 2. For the update, this split of county population was derived from 2015 USGS estimates and were vetted through the regional council and stakeholder review process. **Figure 2-2** shows the split between self-supply versus public-supply water demand for the region.

As in the prior forecasts, it is assumed that all self-supplied (i.e., domestic residential) water use is from groundwater. The allocation of public-supplied municipal water among surface water and groundwater sources was originally determined in Round 1 by an analysis of surface water and groundwater permitted water withdrawals for municipal use by county. The percent of county public-supply municipal water by surface water and groundwater used to allocate the current county municipal water demand by sources was obtained from 2019 permitted withdrawals. The allocation of groundwater by aquifer (for the groundwater models) was also obtained from 2019 permitted withdrawals.

Thus, the current county municipal water demand forecasts are allocated among surface water basins and groundwater aquifers for analysis with other components of the state water plan update. Note that for the Suwannee-Satilla region, all municipal water is groundwater, as shown in **Figure 2-3**.

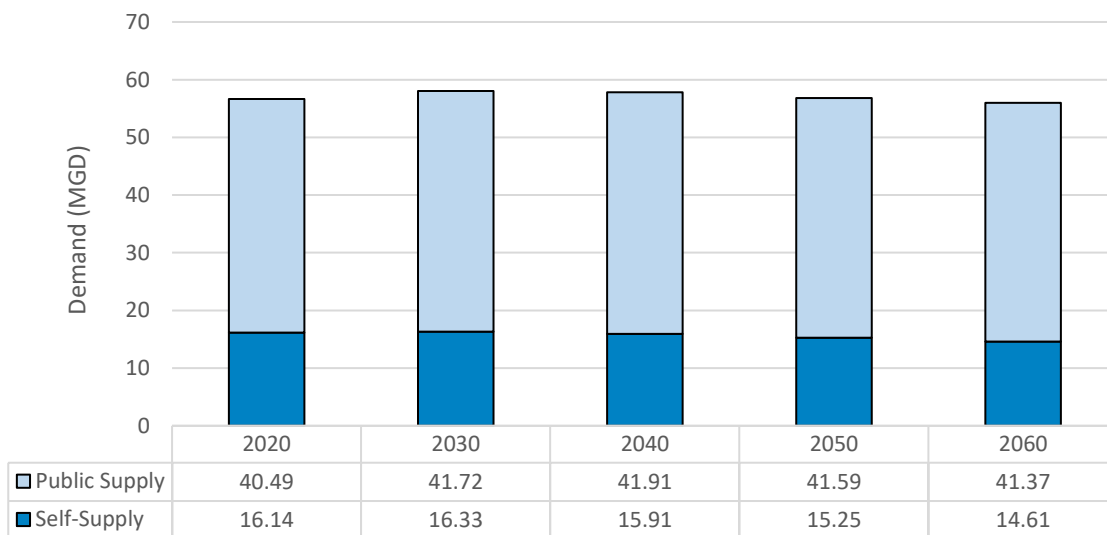


Figure 2-2
Self-Supply Versus Public-Supply of Municipal Water Demand

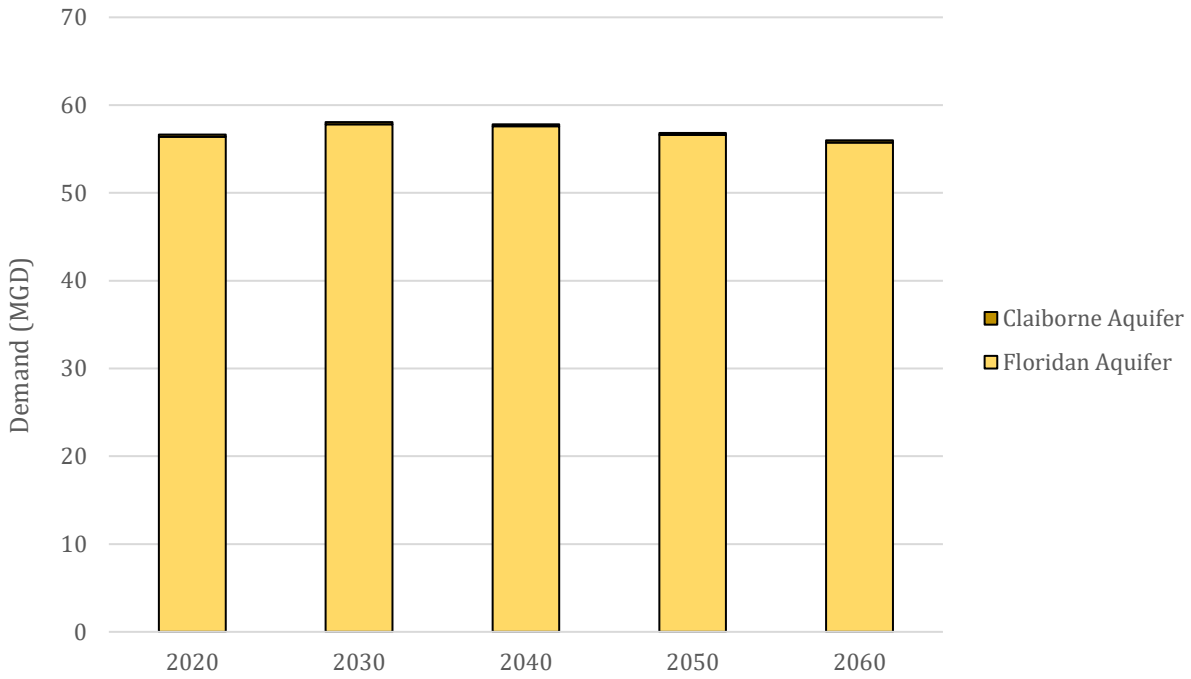


Figure 2-3
Municipal Water Demand for Suwannee-Satilla Planning Council by Aquifer and Basin

Note: Groundwater demand has been assigned to priority aquifers. Gordon aquifer demands were reclassified as Floridan
*Values shown in graph reflect current updated values

Section 3

Municipal Wastewater Forecasting

This section describes the methodology and results of the current municipal wastewater demand forecasts for the Suwannee-Satilla Planning Region.

3.1 Methodology

Within the previous analyses (i.e., Round 1 and Round 2), the municipal water demand served as the basis for estimating the municipal wastewater flows for each county with a portion of the water demand assumed to be indoor use that entered the centralized wastewater treatment system or septic systems. While self-supplied water demand was assumed to go to a septic system, public-supplied water in each county had a proportion going to septic and a portion to centralized treatment based on existing Georgia EPD permit data. Unlike the previous forecasts, a percentage was not added to centralized flows for inflow and infiltration (I/I) as I/I is accounted for in the reported discharge data. The centralized flow estimate was then allocated between point discharge (NPDES) and land application systems (LAS) based on reported discharges.

For the current update, the Georgia EPD provided an analysis of 2019 NPDES permitted discharges by county and a recommended methodology for the municipal wastewater forecast.

- The percent of county total wastewater flow that is septic was estimated based on Georgia Department of Public Health estimates of septic systems installed by county or based on percentage of septic households from 1990 census data.
- Future septic flow by county is estimated using 2019 discharge information by EPD multiplied by the percent change in county population for 2019 and each planning year (2020, 2030, 2040, 2050, and 2060).
- The sum of annual average 2019 NPDES point discharges by county are increased/decreased over time with the rate of change in the new county population projections to derive the new point discharge forecast for the county. The percent of county that is septic/centralized remained constant over time.
- Industrial flows larger than 0.2 MGD that are treated at the municipal wastewater facilities were removed from current flow data, calculated separately, and added back to the population-adjusted municipal wastewater forecast.
- The sum of annual average 2015 – 2019 land application system (LAS) flows by county are combined with 2015 – 2019 subsurface flows (if any), and increased/decreased over time with the rate of change in the new county population projections to derive the new LAS + subsurface forecast for the county.

- The current LAS + subsurface flow forecast for the county is allocated among watershed basins based on the permit locations of the 2015 – 2019 LAS (and subsurface) flows in the county.
- County centralized flow is the sum of the point source discharges and LAS + subsurface discharges.
- County total wastewater flow is the sum of the centralized and septic flows.

3.2 Results

Table 3-1 shows the forecasted municipal wastewater generated per County in the Suwannee-Satilla region. The total regional wastewater generated is then shown graphically in **Figure 3-1** separated between septic treatment and centralized treatment that is discharged via a point source or land application. **Figure 3-2** gives a snapshot of how the generated wastewater is discharged per watershed for 2020.

Table 3-1 Total Wastewater Generated in Suwannee-Satilla Planning Region per County (MGD)

County	2020	2030	2040	2050	2060	% Change 2020 to 2060
Atkinson	0.6	0.6	0.6	0.6	0.6	2%
Bacon	1.2	1.3	1.3	1.2	1.2	-6%
Ben Hill	3.2	3.2	3.1	2.9	2.8	-14%
Berrien	1.8	1.8	1.8	1.8	1.9	6%
Brantley	1.1	1.1	1.1	1.0	0.9	-13%
Brooks	2.3	2.4	2.3	2.1	1.9	-19%
Charlton	1.1	1.1	1.1	1.0	0.9	-17%
Clinch	0.8	0.9	0.9	0.9	1.0	16%
Coffee	5.9	6.0	5.9	5.9	5.8	-2%
Cook	1.7	1.7	1.7	1.6	1.4	-14%
Echols	0.2	0.2	0.2	0.2	0.2	-22%
Irwin	1.1	1.2	1.2	1.2	1.3	11%
Lanier	0.7	0.7	0.7	0.7	0.7	2%
Lowndes	21.2	22.6	23.5	24.3	25.2	19%
Pierce	1.1	1.1	1.1	1.2	1.2	12%
Tift	5.4	5.6	5.7	5.7	5.8	7%
Turner	1.0	1.1	1.0	0.9	0.9	-16%
Ware	2.9	3.0	3.1	3.1	3.2	11%
Total	53.4	55.6	56.3	56.4	56.7	6%

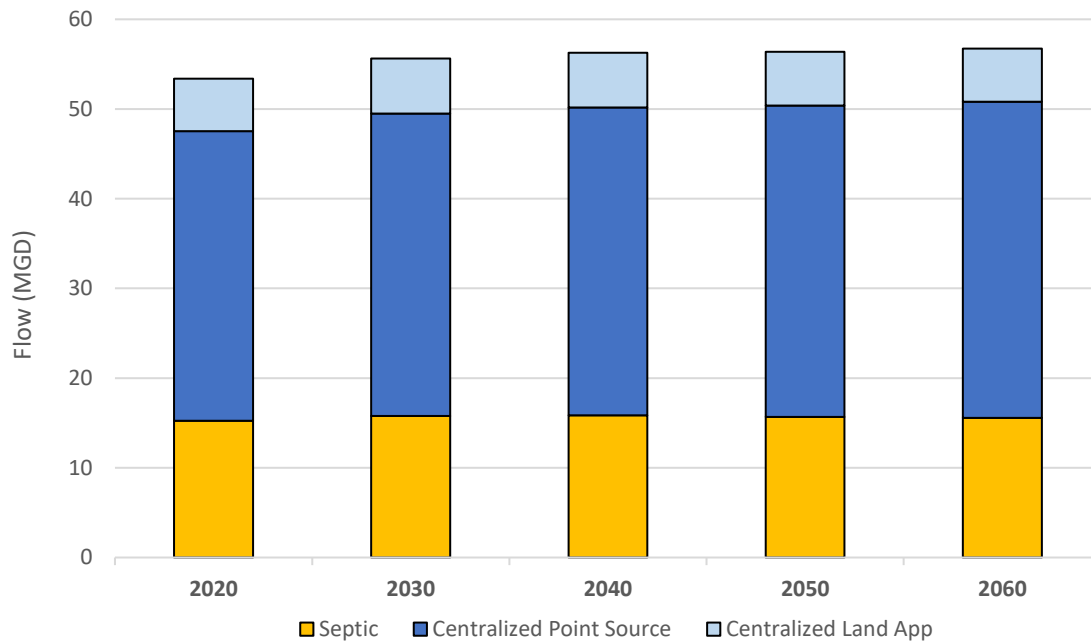


Figure 3-1
Total Wastewater Generated Suwannee-Satilla Planning Region by Type

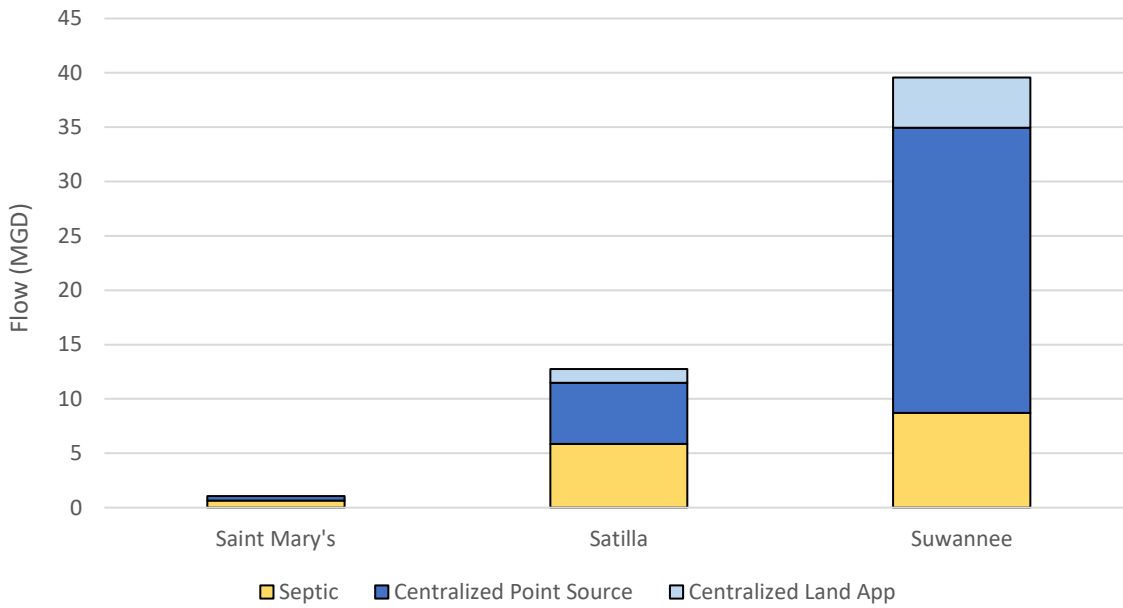


Figure 3-2
2020 Snapshot of Wastewater Discharge Type per Watershed

Section 4

Industrial Forecasting

This section describes the methodology and results of industrial water and wastewater demand forecasts for the Suwannee-Satilla Planning Region.

4.1 Methodology

The original industrial water and wastewater forecast methodology was based on employment projections per industry with the 2010 water use multiplied by the expected employment growth rate into the future for that type of industry. The industrial wastewater flow was then estimated from a wastewater to water ratio developed for each industrial category. The original forecast was not updated during the 2017 forecast revision process.

In support of the current update, EPD identified industrial representatives throughout the State of Georgia to form an industrial water demand forecast stakeholder advisory group to represent the state's thirteen largest industrial water use sectors. It was then determined that employment projections were not a valid basis for estimating future water requirements of industries as water requirements are a function of production of which automation has reduced the number of employees per unit of production. Separate industrial sub-sector groups were subsequently formed to examine trends in water use for food processing, paper and forest products, mining, and manufacturing. The sub-sector advisory groups worked independently to review a variety of considerations for estimating future water demand and determined a variety of common and sector-specific conclusions.

Data was confidentially collected within the sub-sectors through trade association surveys and merged with EPD withdrawal data. The basis of projected water use for the majority of industrial facilities used the 10-year average water withdrawals from 2010 to 2019, however, there were some instances where data was limited to a 5-year average from 2015 or 2019 or reported water use for 2019.

It should be noted that information was shared between the industrial forecast team and the municipal forecast team to adjust for large industries supplied by municipal water systems. As a result, the municipal forecast excludes large industrial users from the calculation of the municipal water use per capita value and then adds the industrial use to the estimated municipal water demand calculations.

4.2 Results

4.2.1 Industrial Water Forecasts

Table 4-1 shows the current (Round 3) industrial water demand by county as well as the percent increase in demand between 2020 and 2060. **Table 4-2** shows the same water demand broken down by industry with the majority of water demand occurring in the paper industrial classification category. Industrial water demand in the region is currently supplied 86 percent from groundwater, 9 percent from municipal water and 5 percent from surface water.

Table 4-1 Industrial Water Demand Forecast per County (MGD)

County	2020	2030	2040	2050	2060	% Change 2020 to 2060
Atkinson	0.40	0.40	0.40	0.40	0.40	0%
Bacon	0.35	0.35	0.35	0.35	0.35	0%
Ben Hill	0.00	0.00	0.00	0.00	0.00	0%
Berrien	0.00	0.00	0.00	0.00	0.00	0%
Brantley	0.00	0.00	0.00	0.00	0.00	0%
Brooks	0.08	0.08	0.08	0.08	0.08	0%
Charlton	0.77	0.77	0.77	0.77	0.77	0%
Clinch	0.04	0.04	0.04	0.04	0.04	0%
Coffee	1.47	1.69	2.01	2.10	2.29	56%
Cook	0.00	0.00	0.00	0.00	0.00	0%
Echols	0.00	0.00	0.00	0.00	0.00	0%
Irwin	0.00	0.00	0.00	0.00	0.00	0%
Lanier	0.00	0.00	0.00	0.00	0.00	0%
Lowndes	10.63	10.63	10.63	10.63	10.63	0%
Pierce	0.15	0.15	0.15	0.15	0.15	0%
Tift	0.00	0.00	0.00	0.00	0.00	0%
Turner	0.00	0.00	0.00	0.00	0.00	0%
Ware	0.36	0.36	0.36	0.36	0.36	0%
Total	14.24	14.46	14.78	14.87	15.06	6%

Table 4-2 Industrial Water Demand Forecast per Industry (MGD)

Industry	2020	2030	2040	2050	2060
Food	1.45	1.67	1.99	2.08	2.28
Manufacturing	1.17	1.17	1.17	1.17	1.17
Mining	0.80	0.80	0.80	0.80	0.80
Paper	10.82	10.82	10.82	10.82	10.82
TOTAL	14.24	14.46	14.78	14.87	15.06

4.2.2 Industrial Wastewater Results

Table 4-3 provides the forecast of industrial wastewater generated per County while **Table 4-4** gives the wastewater demand by discharge method. The majority of industrial wastewater in the Planning Region is discharged via a permitted land application for the industrial facility.

Table 4-3 Industrial Wastewater Generation Forecast per County (MGD)

County	2020	2030	2040	2050	2060	% Change 2020 to 2060
Atkinson	0.10	0.10	0.10	0.10	0.10	0%
Bacon	0.29	0.29	0.29	0.29	0.29	0%
Ben Hill	0.07	0.07	0.07	0.07	0.07	0%
Berrien	0.00	0.00	0.00	0.00	0.00	0%
Brantley	0.00	0.00	0.00	0.00	0.00	0%
Brooks	0.00	0.00	0.00	0.00	0.00	0%
Charlton	0.10	0.10	0.10	0.10	0.10	0%
Clinch	0.00	0.00	0.00	0.00	0.00	0%
Coffee	1.29	1.51	1.82	2.00	2.11	64%
Cook	0.00	0.00	0.00	0.00	0.00	0%
Echols	0.40	0.40	0.40	0.40	0.40	0%
Irwin	0.00	0.00	0.00	0.00	0.00	0%
Lanier	0.00	0.00	0.00	0.00	0.00	0%
Lowndes	10.38	10.38	10.38	10.38	10.38	0%
Pierce	0.09	0.09	0.09	0.09	0.09	0%
Tift	0.00	0.00	0.00	0.00	0.00	0%
Turner	0.00	0.00	0.00	0.00	0.00	0%
Ware	0.00	0.00	0.00	0.00	0.00	0%
Total	12.72	12.94	13.25	13.43	13.53	6%

Table 4-4 Industrial Wastewater Generation Forecast by Discharge Method (MGD)

Discharge Method	2020	2030	2040	2050	2060
Industrial – Point Source	0.79	0.79	0.79	0.79	0.79
Industrial – LAS	10.50	10.50	10.50	10.50	10.50
Industrial to Municipal Publicly Owned Treatment Plant (POTW)	1.43	1.65	1.96	2.14	2.25
Total Industrial Discharge	12.72	12.94	13.25	13.43	13.53

Section 5

Agricultural Water Forecasting

This section describes the methodology and results of agricultural water demand forecasting for the Suwannee-Satilla Planning Region.

5.1 Methodology

Agricultural water demand forecasts were originally developed, and recently updated, by the Georgia Water Planning & Policy Center at Albany State University (GWPPC), with support from the University of Georgia's (UGA) College of Agricultural and Environmental Sciences. GWPPC was contracted by Georgia Environmental Protection Division (GAEPD) to prepare estimates of current and future use of water by the agricultural sector in Georgia. The basic methodology involved estimating the projected irrigated area for each crop type and multiplying that area by the predicted monthly irrigation need in inches per each crop type. The proportion of irrigation water derived from different water source types was also considered. The projections cover row and orchard crops as well as most vegetable and specialty crops accounting for more than 95 percent of Georgia's irrigated land. Additionally, estimates of current use are made for animal agriculture, horticultural nurseries and greenhouses, as well as golf courses.

Field observations, aerial surveys, and remote sensing were used to identify the 2020 irrigated acres by county. USDA projections, the Southeast Model, Georgia Model and data trends were used by the project team to project crop acreage by county through 2060. The number of irrigated acres has increased from 2015 to 2020 in most counties. Therefore, the projected irrigated crop acreage for 2060 is higher than previous forecasts for most counties. Crop water needs estimates from 2015-2016 were reviewed and updated with data from recent crop metering data. Prior agricultural forecasts assumed that only 70 percent of surface water withdrawals were applied. This assumption was removed for the updated forecast. Estimates were developed for crop irrigation from groundwater and surface water from 2020 to 2060. Water use estimates for animals and horticulture were estimated by county for 2020 and held constant over time. Water use for animals and horticulture is assumed to be groundwater.

To address potential climate extremes, a range of agricultural demand scenarios were considered including wet, normal and dry years. The 75th percentile of water demand was selected to represent dry year conditions when higher irrigation demands are expected. For planning purposes, GWPPC used the 75th percentile values for each region to represent a more conservative scenario than the median value. It is the 75th percentile demands that are presented in this report.

5.2 Results

Table 5-1 shows the forecasted agricultural water needs by county in the Suwannee-Satilla region. The Suwannee-Satilla region as a whole is expected to see an increase of 30 percent in agricultural water demand by 2060. **Figure 5-1** shows the agricultural demands split by basin for surface water and aquifer for groundwater with the same data also provided in **Table 5-2**. Currently 73 percent of the agricultural demand in the Suwannee-Satilla region is met from groundwater.

Table 5-1 Suwannee-Satilla Agricultural Demand Forecast by County (MGD)

County	2020	2030	2040	2050	2060	Percent Increase 2020 to 2060
Atkinson	9.2	9.7	10.2	10.7	11.2	22%
Bacon	8.2	8.6	9.1	10.1	10.4	28%
Ben Hill	11.1	11.7	12.4	13.0	14.2	27%
Berrien	24.6	26.3	28.6	31.3	34.2	39%
Brantley	0.73	0.77	0.81	0.83	0.92	26%
Brooks	29.6	31.8	33.9	36.3	39.1	32%
Charlton	0.02	0.02	0.02	0.02	0.02	0%
Clinch	3.3	3.4	3.7	3.9	4.3	30%
Coffee	19.2	20.1	21.1	22.1	23.4	22%
Cook	16.9	17.8	18.9	20.2	21.5	27%
Echols	2.5	2.4	2.5	2.6	2.7	8%
Irwin	36.9	38.6	40.7	43.0	45.5	24%
Lanier	6.3	6.8	7.6	8.5	9.5	51%
Lowndes	11.9	13.2	14.9	16.9	19.2	62%
Pierce	11.9	12.4	13.1	13.9	14.9	25%
Tift	21.4	22.8	24.0	25.5	27.0	26%
Turner	27.7	29.4	31.2	33.3	35.6	29%
Ware	5.5	5.8	6.2	6.7	7.2	31%
Total	246.7	261.4	279.0	298.7	321.0	30%

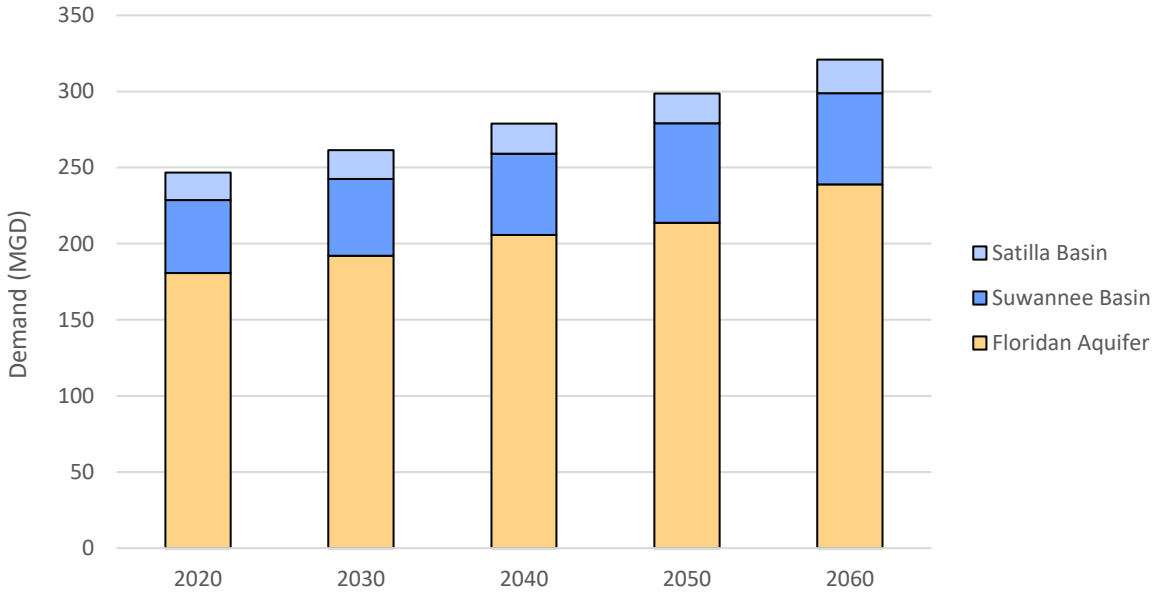


Figure 5-1
Agricultural Water Demand by Source Water Type

Table 5-2 Suwannee-Satilla Agricultural Demand Forecast per Source (MGD)

Source Water Type	Basin/Aquifer	2020	2030	2040	2050	2060	Percent Increase 2020 to 2060
Surface Water	Suwannee	48.0	50.5	53.3	65.4	59.8	25%
	Satilla	18.0	18.9	19.9	19.5	22.2	23%
	Sub Total	66.0	69.4	73.2	84.9	82.0	24%
Groundwater	Floridan	180.7	192.1	205.8	213.8	239.0	32%
	Sub Total	180.7	192.1	205.8	213.8	239.0	32%
Total		246.7	261.4	279.0	298.7	321.0	30%

Section 6

Energy Water Forecasting

This section describes the methodology and results of energy sector water demand for the Suwannee-Satilla Planning Region.

6.1 Methodology

Demands forecasted in this section are associated with future energy sector utilities (NAICS 22) power generation. Water demands associated with power generation by facilities with other industry codes are captured as part of the municipal and industrial water demand forecasts discussed in previous sections.

The analysis covers both water withdrawal requirements and water consumption associated with energy generation. Information related to water withdrawals is an important consideration in planning for the water needed for energy production. However, water consumption is the more important element when assessing future resources because a large volume of water is typically returned to the environment following the energy production process.

Water requirements for thermoelectric power generation facilities are estimated based on future energy demands along with the water requirements and consumption rates in gallons per megawatt-hour (MWh) for different power generating configurations. For a full discussion of the original forecast methodology see the 2010 technical memorandum “Statewide Energy Sector Water Demand Forecast” or the “Update of GA Energy Needs & Generating Facilities” memorandum. The following modification to the original methodology were incorporated into the current estimates:

- Projections of the statewide energy demand were updated using the new population projections to estimate “High Demand” and “Expected Demand” scenarios. Values of 10 MWh and 11 MWh per capita were assumed for the High Demand and Expected Demand scenarios, respectively.
- The list of existing facilities, facilities under construction, and planned and permitted new facilities was updated and reviewed by the stakeholder advisory group. In addition, some prior facilities were retired from service or converted from one generating configuration to another configuration. It was assumed that all coal-fired generating facilities in Georgia will be retired by 2040.
- The same water withdrawal and consumptive use factors (gallons per MWh) by generating configuration were maintained as previously developed.
- To meet the future energy demand, the energy generation of existing facilities is increased over time to a predetermined maximum sustainable generating capacity based on the generation configuration. As additional capacity is needed in the future, “new” capacity is added to the most likely to be developed generating configurations, which are assumed to

be provided by natural gas and renewable energy. The increase in natural gas generation was assigned geographically to locations in which natural gas generating facilities currently exist.

- The estimated future generating capacity of existing facilities, and associated water requirements, is allocated to regions based on the location of the existing facilities.

6.2 Results

As shown in **Table 6-1**, there is no forecasted energy production or associated water demand in the Suwannee-Satilla Region. Currently, there is no planned energy production facility in the region.

Table 6-1 Suwannee-Satilla Forecasted Energy Sector Demands (MGD)

Demand Type	2020	2030	2040	2050	2060
Withdrawals	0	0	0	0	0
Consumption	0	0	0	0	0

In the previous statewide analysis, the generating capacity of the existing and planned facilities was not able to meet the projected statewide power needs through 2050 and additional generating capacity was assumed to be developed beyond 2020. Projections for the need of new energy capacity are less than estimated previously. Under the current energy forecasting effort, it was determined that planned generation levels will be sufficient enough to meet the expected need up to 2036. Because coal-fired generation is expected to decline and be retired by 2040, renewable energy and natural gas-fired facilities will be increased to generate the additional energy required to meet the expected demand.

Section 7

Regional Summary

This section summarizes the water and wastewater forecasts within the region for all the sectors combined.

7.1 Water Demand Summary

The full regional water demand including municipal, industrial, agricultural and energy uses are summarized in the figures and tables of this section. **Figure 7-1** shows the regional water demand per basin for surface water withdrawals and per aquifer for groundwater withdrawals while **Figure 7-2** shows the regional water demand per sector. Municipally-supplied industrial demand is removed from these totals to avoid double-counting. **Figure 7-3** shows the sector breakdown by County for 2020. **Table 7-1** provides a breakdown of the demand types per County for the whole planning period.

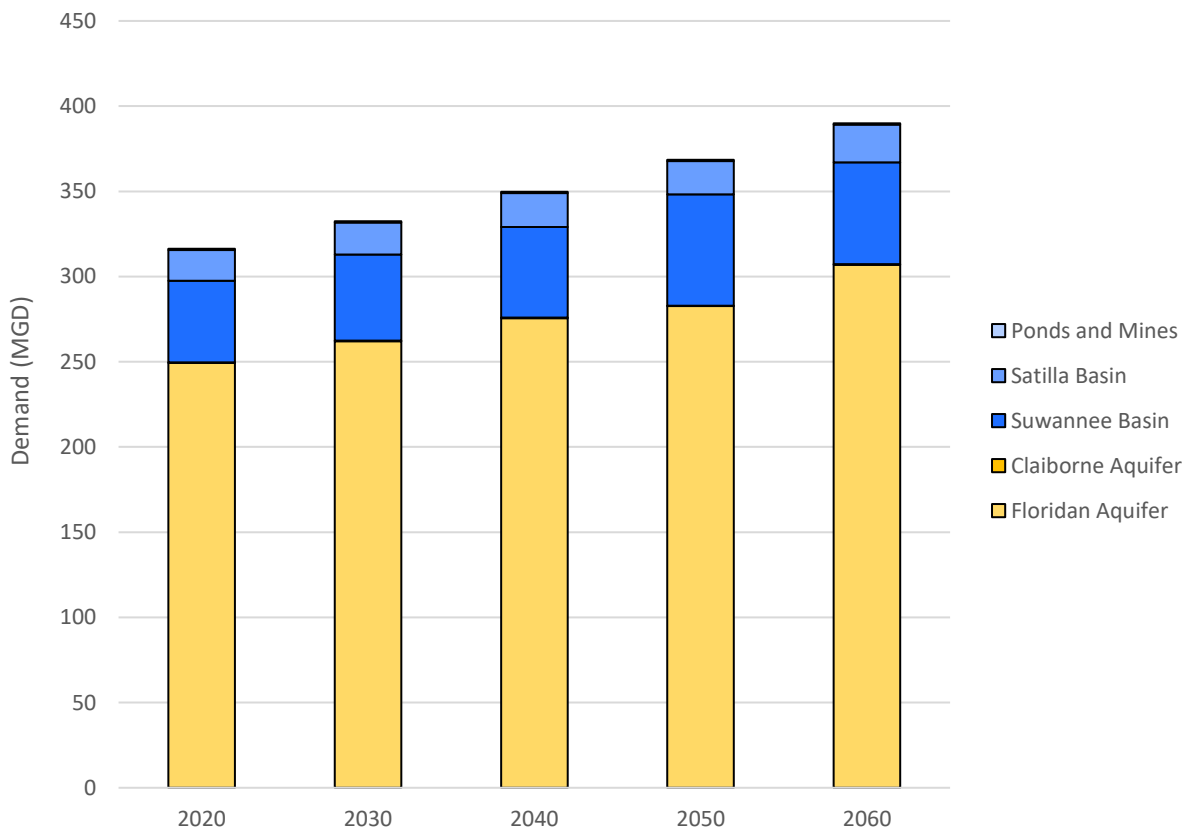


Figure 7-1
Regional Water Demand by Basin and Aquifer

Note: Groundwater demand has been assigned to priority aquifers. Gordon aquifer demands were reclassified as Floridan

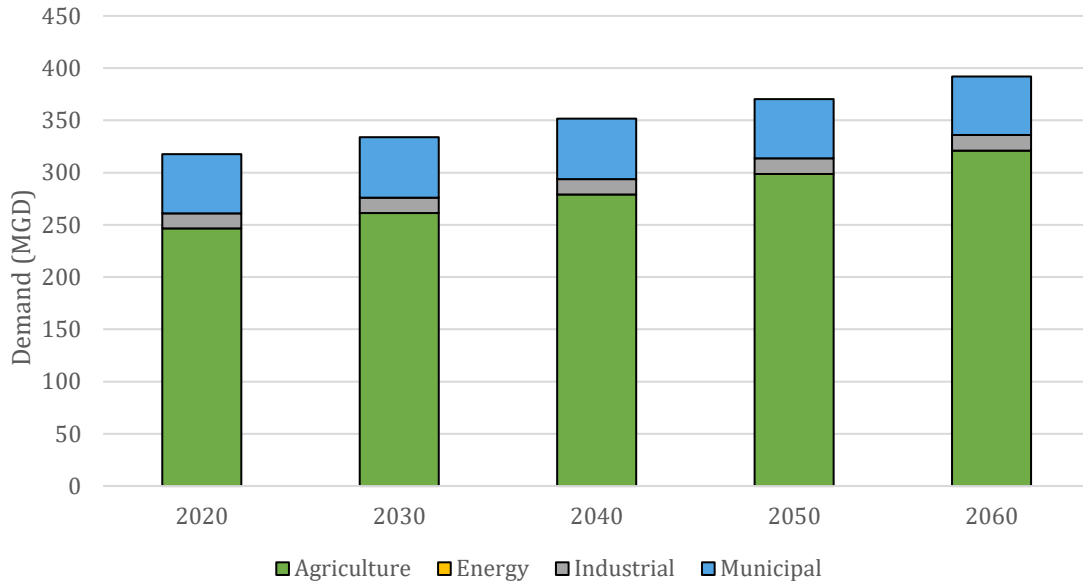


Figure 7-2
Regional Water Demand by Sector

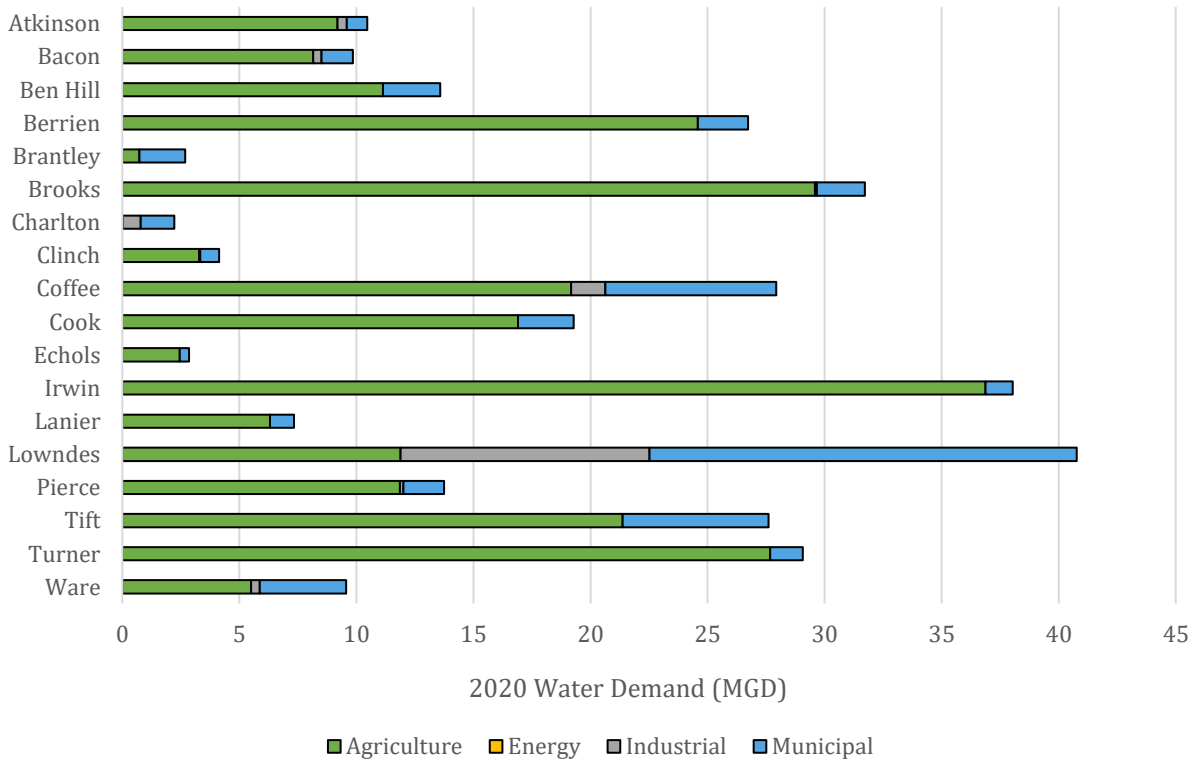


Figure 7-3
County Water Demand by Sector for 2020

Table 7-1 Summary of Water Demand per County (MGD)

County	Sector	2020	2030	2040	2050	2060
Atkinson	GW Agricultural	7.44	7.82	8.21	7.81	9.08
	GW Industrial	0.39	0.39	0.39	0.39	0.39
	GW Municipal Public Supply	0.48	0.48	0.47	0.46	0.44
	GW Municipal Self Supply	0.40	0.40	0.39	0.37	0.36
	Groundwater Total	8.70	9.09	9.46	9.03	10.27
	SW Agricultural	1.75	1.84	1.94	2.88	2.17
	Total	10.45	10.93	11.40	11.91	12.44
Bacon	GW Agricultural	6.70	7.05	7.52	6.63	8.60
	GW Industrial	0.35	0.35	0.35	0.35	0.35
	GW Municipal Public Supply	0.70	0.73	0.70	0.65	0.60
	GW Municipal Self Supply	0.65	0.67	0.64	0.59	0.54
	Groundwater Total	8.40	8.80	9.21	8.22	10.09
	SW Agricultural	1.45	1.52	1.61	3.42	1.81
	Total	9.85	10.32	10.82	11.64	11.91
Ben Hill	GW Agricultural	8.29	8.72	9.27	9.04	10.58
	GW Municipal Public Supply	2.02	1.95	1.85	1.72	1.62
	GW Municipal Self Supply	0.42	0.41	0.38	0.35	0.33
	Groundwater Total	10.74	11.08	11.50	11.11	12.53
	SW Agricultural	2.84	2.99	3.18	3.97	3.62
Total	13.58	14.07	14.68	15.07	16.15	
Berrien	GW Agricultural	16.72	18.11	19.92	23.72	24.47
	GW Municipal Public Supply	0.98	0.99	0.98	0.97	0.95
	GW Municipal Self Supply	1.17	1.18	1.16	1.13	1.11
	Groundwater Total	18.87	20.28	22.06	25.82	26.53
	SW Agricultural	7.86	8.23	8.69	7.56	9.75
	Total	26.73	28.52	30.75	33.38	36.27
Brantley	GW Agricultural	0.56	0.58	0.62	0.54	0.70
	GW Municipal Public Supply	0.28	0.29	0.28	0.26	0.23
	GW Municipal Self Supply	1.68	1.73	1.65	1.50	1.32
	Groundwater Total	2.52	2.60	2.55	2.30	2.25
	SW Agricultural	0.17	0.18	0.19	0.30	0.22
Total	2.69	2.79	2.74	2.59	2.47	
Brooks	GW Agricultural	28.36	30.45	32.54	28.67	37.58
	GW Industrial	0.08	0.08	0.08	0.08	0.08
	GW Municipal Public Supply	1.25	1.26	1.18	1.05	0.94
	GW Municipal Self Supply	0.80	0.80	0.74	0.65	0.58
	Groundwater Total	30.49	32.59	34.54	30.45	39.18
	SW Agricultural	1.23	1.30	1.36	7.64	1.50
	Total	31.72	33.89	35.90	38.09	40.68
Charlton	GW Agricultural	0.02	0.02	0.02	0.02	0.02
	GW Industrial	0.07	0.07	0.07	0.07	0.07
	GW Municipal Public Supply	0.82	0.83	0.78	0.70	0.62
	GW Municipal Self Supply	0.62	0.62	0.58	0.52	0.46
	Groundwater Total	1.52	1.54	1.45	1.31	1.17
	SW Industrial	0.70	0.70	0.70	0.70	0.70
Total	2.22	2.24	2.15	2.01	1.87	
Clinch	GW Agricultural	3.13	3.28	3.53	3.26	4.08
	GW Industrial	0.04	0.04	0.04	0.04	0.04
	GW Municipal Public Supply	0.53	0.53	0.53	0.54	0.56

County	Sector	2020	2030	2040	2050	2060
	GW Municipal Self Supply	0.29	0.29	0.28	0.29	0.30
	Groundwater Total	3.99	4.14	4.38	4.13	4.98
	SW Agricultural	0.16	0.17	0.18	0.67	0.21
	Total	4.15	4.31	4.56	4.80	5.19
Coffee	GW Agricultural	11.25	11.76	12.32	16.97	13.62
	GW Industrial	0.17	0.17	0.17	0.17	0.17
	GW Municipal Public Supply	5.34	5.34	5.58	5.67	5.68
	GW Municipal Self Supply	2.14	2.14	2.08	2.00	1.92
	Groundwater Total	18.90	19.41	20.15	24.81	21.39
	SW Agricultural	7.92	8.31	8.74	5.18	9.73
	Total	26.82	27.72	28.89	29.99	31.13
Cook	GW Agricultural	12.88	13.55	14.40	14.24	16.45
	GW Municipal Public Supply	1.58	1.58	1.51	1.38	1.24
	GW Municipal Self Supply	0.85	0.85	0.80	0.73	0.64
	Groundwater Total	15.31	15.98	16.71	16.35	18.33
	SW Agricultural	4.03	4.26	4.51	5.91	5.09
	Total	19.34	20.23	21.22	22.26	23.42
Echols	GW Agricultural	2.04	2.01	2.07	1.82	2.19
	GW Municipal Public Supply	0.00	0.00	0.00	0.00	0.00
	GW Municipal Self Supply	0.40	0.38	0.35	0.31	0.28
	Groundwater Total	2.44	2.39	2.42	2.13	2.47
	SW Agricultural	0.41	0.41	0.43	0.74	0.47
	Total	2.85	2.80	2.85	2.87	2.94
Irwin	GW Agricultural	22.40	23.47	24.81	30.79	27.93
	GW Municipal Public Supply	0.54	0.55	0.56	0.56	0.56
	GW Municipal Self Supply	0.63	0.64	0.63	0.63	0.62
	Groundwater Total	23.56	24.66	26.00	31.98	29.11
	SW Agricultural	14.48	15.11	15.88	12.20	17.62
	Total	38.04	39.77	41.87	44.18	46.73
Lanier	GW Agricultural	5.83	6.31	7.03	4.00	8.86
	GW Municipal Public Supply	0.41	0.40	0.40	0.39	0.38
	GW Municipal Self Supply	0.62	0.61	0.60	0.59	0.58
	Groundwater Total	6.86	7.32	8.03	4.98	9.82
	SW Agricultural	0.48	0.50	0.55	4.49	0.65
	Total	7.34	7.82	8.57	9.47	10.46
Lowndes	GW Agricultural	10.31	11.46	13.00	13.01	16.96
	GW Industrial	10.63	10.63	10.63	10.63	10.63
	GW Municipal Public Supply	15.79	16.61	17.03	17.36	17.79
	GW Municipal Self Supply	2.46	2.56	2.60	2.62	2.66
	Groundwater Total	39.19	41.26	43.26	43.62	48.04
	SW Agricultural	1.58	1.70	1.87	3.86	2.29
	Total	40.77	42.97	45.13	47.48	50.33
Pierce	GW Agricultural	9.94	10.39	11.02	9.26	12.56
	GW Industrial	0.15	0.15	0.15	0.15	0.15
	GW Municipal Public Supply	0.59	0.60	0.59	0.58	0.57
	GW Municipal Self Supply	1.14	1.15	1.16	1.15	1.14
	Groundwater Total	11.82	12.29	12.92	11.14	14.42
	SW Agricultural	1.92	1.99	2.09	4.63	2.32
	Total	13.74	14.28	15.00	15.77	16.74

County	Sector	2020	2030	2040	2050	2060
Tift	GW Agricultural	12.55	13.40	14.20	17.19	16.07
	GW Municipal Public Supply	4.91	5.01	5.02	4.98	4.94
	GW Municipal Self Supply	1.33	1.34	1.33	1.30	1.27
	Groundwater Total	18.80	19.75	20.55	23.47	22.28
	SW Agricultural	8.81	9.36	9.84	8.27	10.93
	Total	27.61	29.12	30.39	31.74	33.21
Turner	GW Agricultural	18.46	19.65	20.99	23.41	24.18
	GW Municipal Public Supply	1.12	1.14	1.07	0.98	0.90
	GW Municipal Self Supply	0.28	0.28	0.26	0.23	0.21
	Groundwater Total	19.86	21.07	22.32	24.62	25.29
	SW Agricultural	9.21	9.71	10.24	9.89	11.43
	Total	29.08	30.78	32.55	34.51	36.72
Ware	GW Agricultural	3.82	4.03	4.34	3.37	5.08
	GW Industrial	0.36	0.36	0.36	0.36	0.36
	GW Municipal Public Supply	3.41	3.42	3.40	3.36	3.35
	GW Municipal Self Supply	0.29	0.29	0.29	0.28	0.28
	Groundwater Total	7.88	8.10	8.39	7.37	9.07
	SW Agricultural	1.69	1.77	1.88	3.32	2.16
	Total	9.56	9.86	10.27	10.69	11.23
Planning Region Total Groundwater Demand		249.8	262.4	275.9	282.8	307.2
Planning Region Total Surface Water Demand		66.7	70.1	73.9	85.6	82.7
Planning Region Total Demand		316.5	332.4	349.8	368.5	389.9

7.2 Wastewater Summary

The regional wastewater forecasts including municipal and industrial discharges are summarized in the figures and tables of this section. Industrial discharge to municipal wastewater treatment systems is removed to avoid double-counting. **Figure 7-4** shows the wastewater discharges per basin while **Figure 7-5** shows the forecasted discharge per method. **Table 7-2** provides a summary of the discharge type per county.

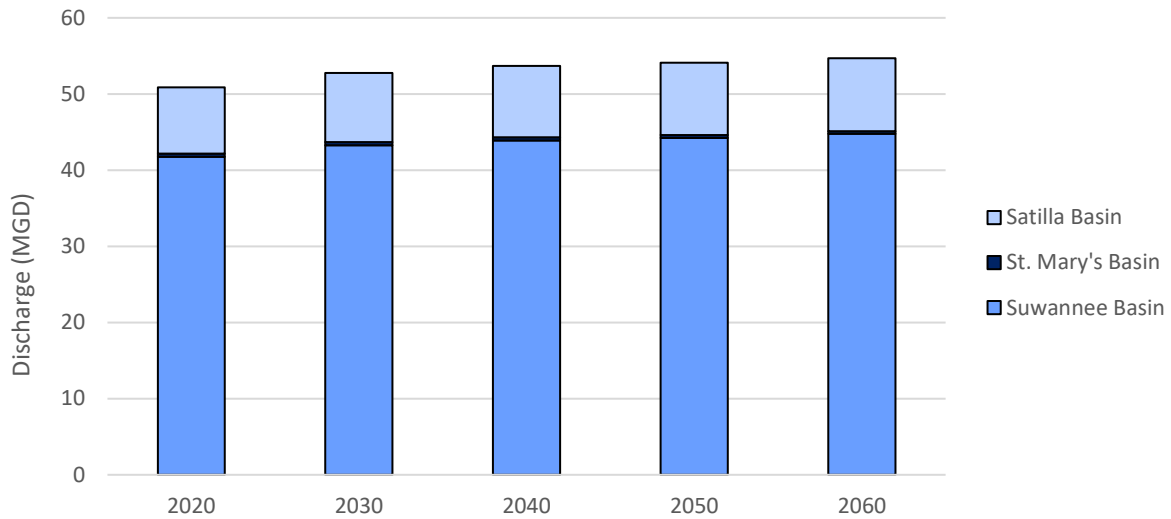


Figure 7-4
Regional Wastewater Discharge per Basin

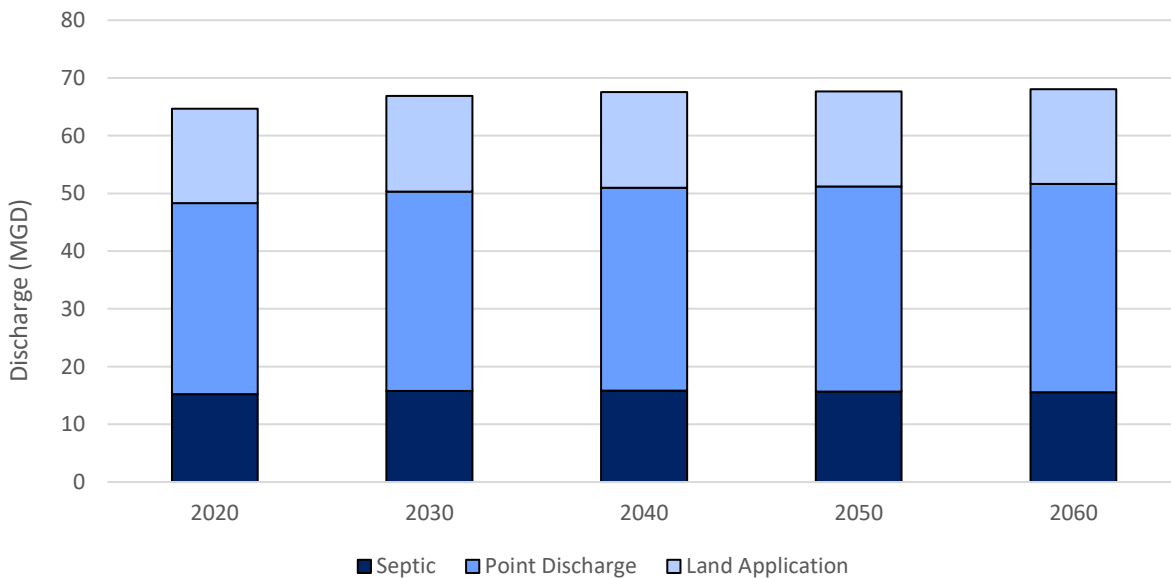


Figure 7-5
Regional Wastewater Discharge per Method

Table 7-2 Summary of Regional Wastewater Flows per County (MGD)

County	Discharge Type	2020	2030	2040	2050	2060
Atkinson	Land Application	0.09	0.09	0.09	0.09	0.09
	Point Discharge	0.31	0.31	0.31	0.31	0.31
	Septic	0.30	0.31	0.31	0.31	0.30
	Total	0.69	0.71	0.71	0.71	0.70
Bacon	Land Application	0.34	0.36	0.36	0.34	0.32
	Point Discharge	0.46	0.48	0.47	0.45	0.44
	Septic	0.58	0.62	0.61	0.58	0.55
	Total	1.38	1.46	1.44	1.38	1.31
Ben Hill	Land Application	0.24	0.24	0.23	0.22	0.21
	Point Discharge	2.24	2.21	2.12	2.02	1.94
	Septic	0.82	0.81	0.77	0.74	0.70
	Total	3.31	3.25	3.13	2.97	2.85
Berrien	Land Application	0.00	0.00	0.00	0.00	0.00
	Point Discharge	0.85	0.88	0.89	0.89	0.90
	Septic	0.91	0.94	0.95	0.95	0.96
	Total	1.76	1.82	1.84	1.85	1.86
Brantley	Land Application	0.02	0.02	0.02	0.02	0.02
	Point Discharge	0.00	0.00	0.00	0.00	0.00
	Septic	1.06	1.12	1.09	1.02	0.92
	Total	1.08	1.14	1.12	1.04	0.94
Brooks	Land Application	1.71	1.76	1.66	1.51	1.38
	Point Discharge	0.00	0.00	0.00	0.00	0.00
	Septic	0.64	0.66	0.62	0.56	0.51
	Total	2.35	2.41	2.28	2.08	1.89
Charlton	Land Application	0.00	0.00	0.00	0.00	0.00
	Point Discharge	0.53	0.55	0.53	0.49	0.46
	Septic	0.65	0.67	0.64	0.59	0.54
	Total	1.18	1.22	1.17	1.09	1.00
Clinch	Land Application	0.00	0.00	0.00	0.00	0.00
	Point Discharge	0.55	0.57	0.58	0.60	0.64
	Septic	0.29	0.30	0.31	0.32	0.34
	Total	0.84	0.87	0.89	0.92	0.98
Coffee	Land Application	0.53	0.53	0.53	0.52	0.52
	Point Discharge	3.81	3.84	3.82	3.79	3.76
	Septic	1.56	1.58	1.57	1.55	1.53
	Total	5.90	5.96	5.93	5.87	5.81
Cook	Land Application	0.00	0.00	0.00	0.00	0.00
	Point Discharge	1.17	1.23	1.18	1.10	1.01
	Septic	0.49	0.51	0.49	0.46	0.42
	Total	1.66	1.74	1.68	1.56	1.42

Table 7-2 Summary of Regional Wastewater Flows per County (MGD)

County	Discharge Type	2020	2030	2040	2050	2060
Echols	Land Application	0.40	0.40	0.40	0.40	0.40
	Point Discharge	0.00	0.00	0.00	0.00	0.00
	Septic	0.24	0.23	0.22	0.20	0.19
	Total	0.64	0.63	0.62	0.60	0.58
Irwin	Land Application	0.63	0.65	0.67	0.68	0.70
	Point Discharge	0.00	0.00	0.00	0.00	0.00
	Septic	0.50	0.52	0.53	0.54	0.56
	Total	1.13	1.17	1.20	1.22	1.25
Lanier	Land Application	0.00	0.00	0.00	0.00	0.00
	Point Discharge	0.15	0.15	0.15	0.15	0.15
	Septic	0.56	0.56	0.57	0.57	0.57
	Total	0.71	0.71	0.72	0.72	0.73
Lowndes	Land Application	11.97	12.09	12.17	12.24	12.33
	Point Discharge	16.64	17.72	18.41	19.02	19.76
	Septic	2.96	3.16	3.28	3.39	3.53
	Total	31.57	32.98	33.86	34.65	35.61
Pierce	Land Application	0.28	0.29	0.30	0.31	0.31
	Point Discharge	0.09	0.09	0.09	0.09	0.09
	Septic	0.77	0.81	0.83	0.85	0.87
	Total	1.15	1.19	1.22	1.25	1.27
Tift	Land Application	0.08	0.09	0.09	0.09	0.09
	Point Discharge	4.37	4.52	4.60	4.63	4.66
	Septic	0.94	0.98	0.99	1.00	1.01
	Total	5.40	5.58	5.68	5.71	5.75
Turner	Land Application	0.07	0.07	0.07	0.06	0.06
	Point Discharge	0.62	0.64	0.60	0.56	0.52
	Septic	0.35	0.37	0.35	0.32	0.30
	Total	1.04	1.08	1.01	0.95	0.88
Ware	Land Application	0.00	0.00	0.00	0.00	0.00
	Point Discharge	1.29	1.33	1.36	1.39	1.43
	Septic	1.60	1.65	1.69	1.72	1.77
	Total	2.89	2.98	3.05	3.11	3.20
Total	Land Application	16.36	16.60	16.58	16.49	16.42
	Point Discharge	33.09	34.51	35.13	35.51	36.06
	Septic	15.23	15.79	15.83	15.68	15.56
Grand Total		64.7	66.9	67.6	67.7	68.0

Section 8

References

2017 Suwannee-Satilla Regional Water Plan. Suwannee-Satilla Regional Water Planning Council. June 2017. <https://waterplanning.georgia.gov/suwannee-satilla-regional-water-plan>

Black & Veatch. 2020. Final Municipal Forecasting Methods Report; Report. <https://waterplanning.georgia.gov/forecasting/municipal-water-use>

CDM Smith. 2020. Statewide Energy Sector Water Demand Forecast; Technical Memorandum. <https://waterplanning.georgia.gov/forecasting/energy-water-use>

CDM Smith. 2020. Industrial Water Demand Forecast; Technical Memorandum. <https://waterplanning.georgia.gov/forecasting/industrial-water-use>